



# Cytoflex 15

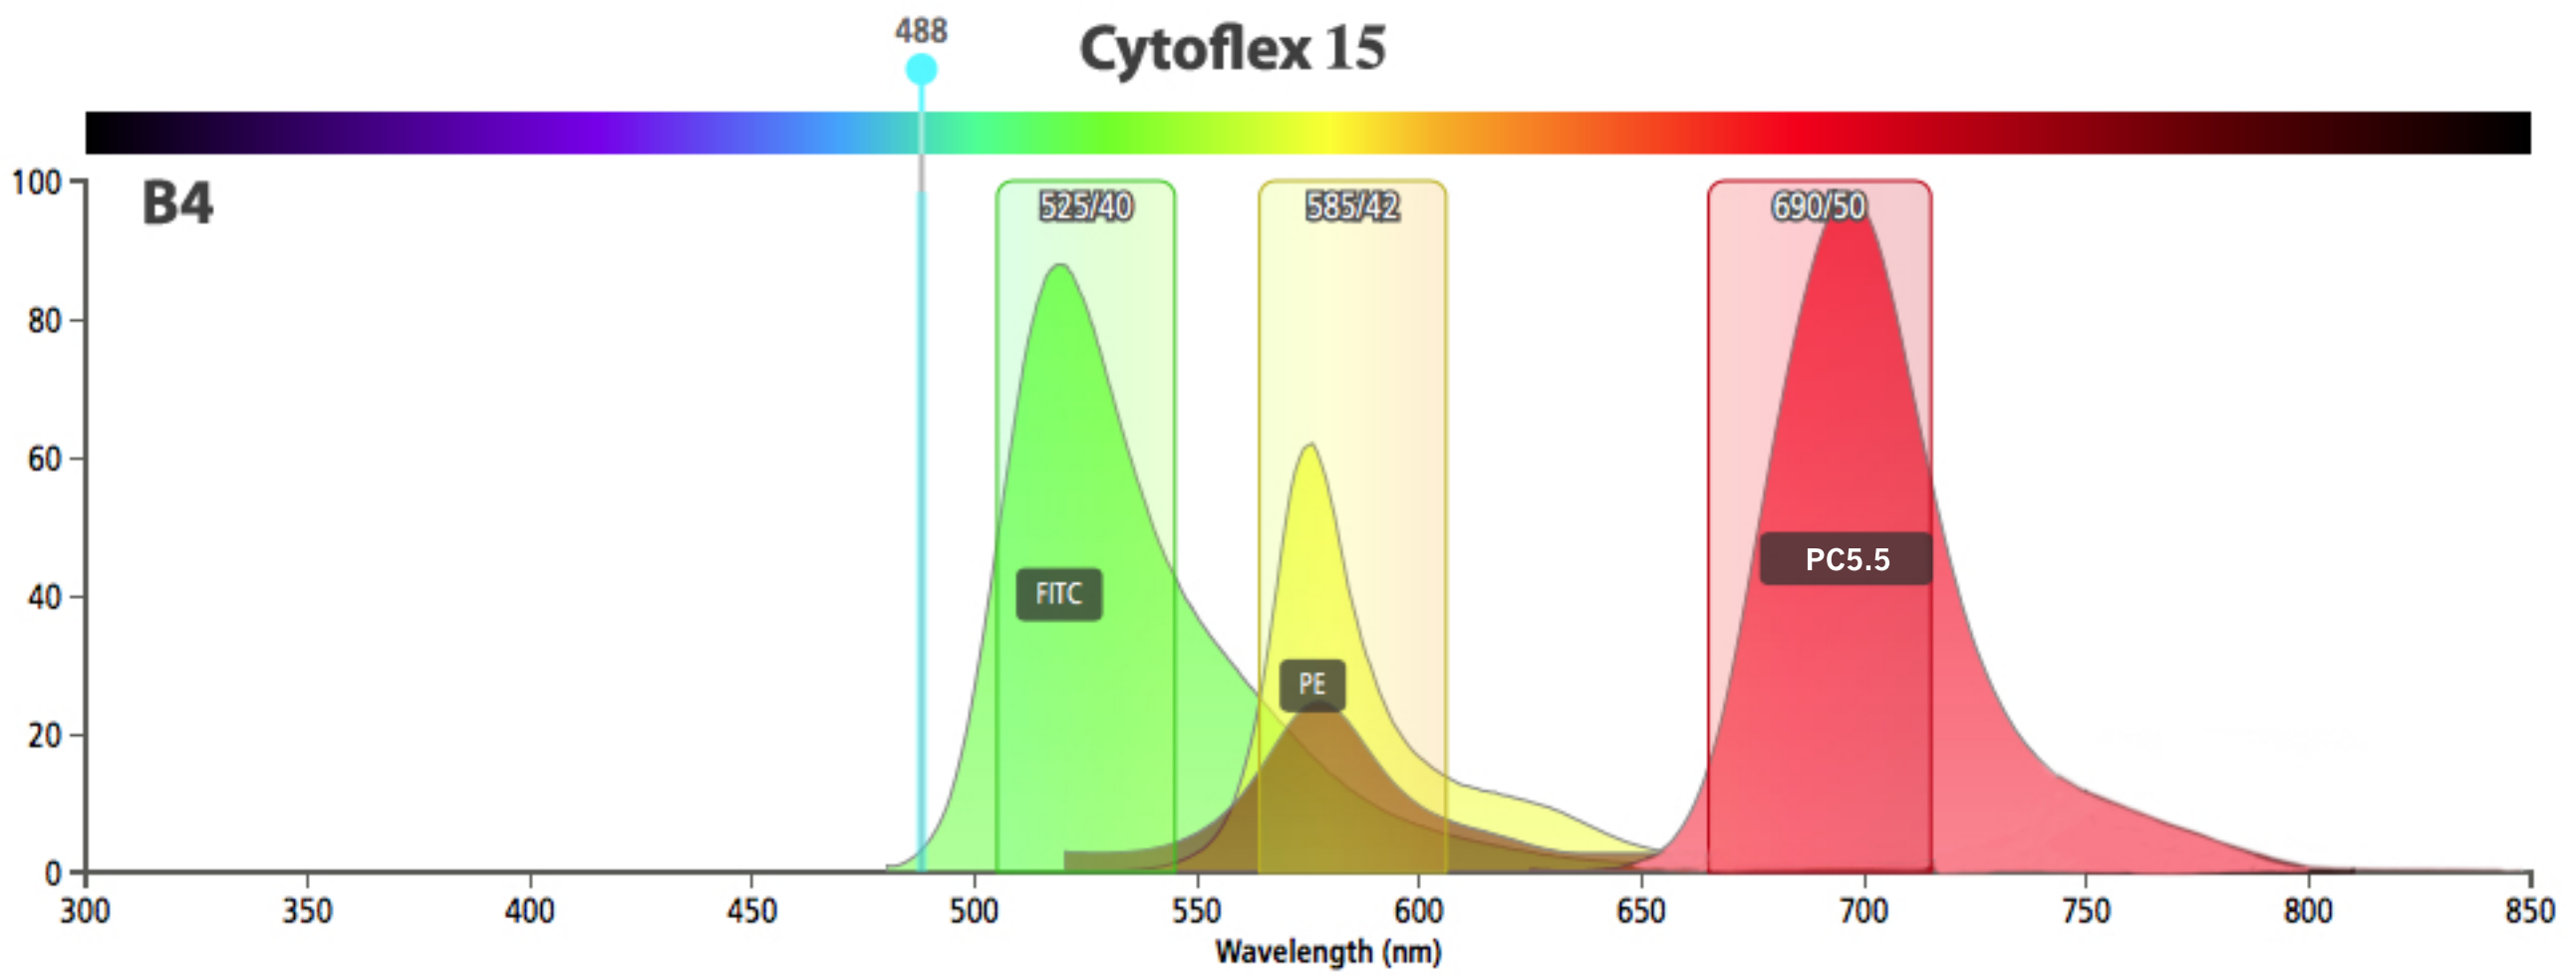

Fluorochrome	%Max	<input type="checkbox"/> Ex	<input checked="" type="checkbox"/> Em	Filters	<input checked="" type="checkbox"/> FITC	<input checked="" type="checkbox"/> PE	<input checked="" type="checkbox"/> PC5.5
1 FITC	88.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	525/40	62.9%	0.4%	x
2 PE	61.6	<input type="checkbox"/>	<input checked="" type="checkbox"/>	585/42	12.5%	70.4%	x
3 PerCP-Cy5.5	98.4	<input type="checkbox"/>	<input checked="" type="checkbox"/>	690/50	x	2.8%	73.6%

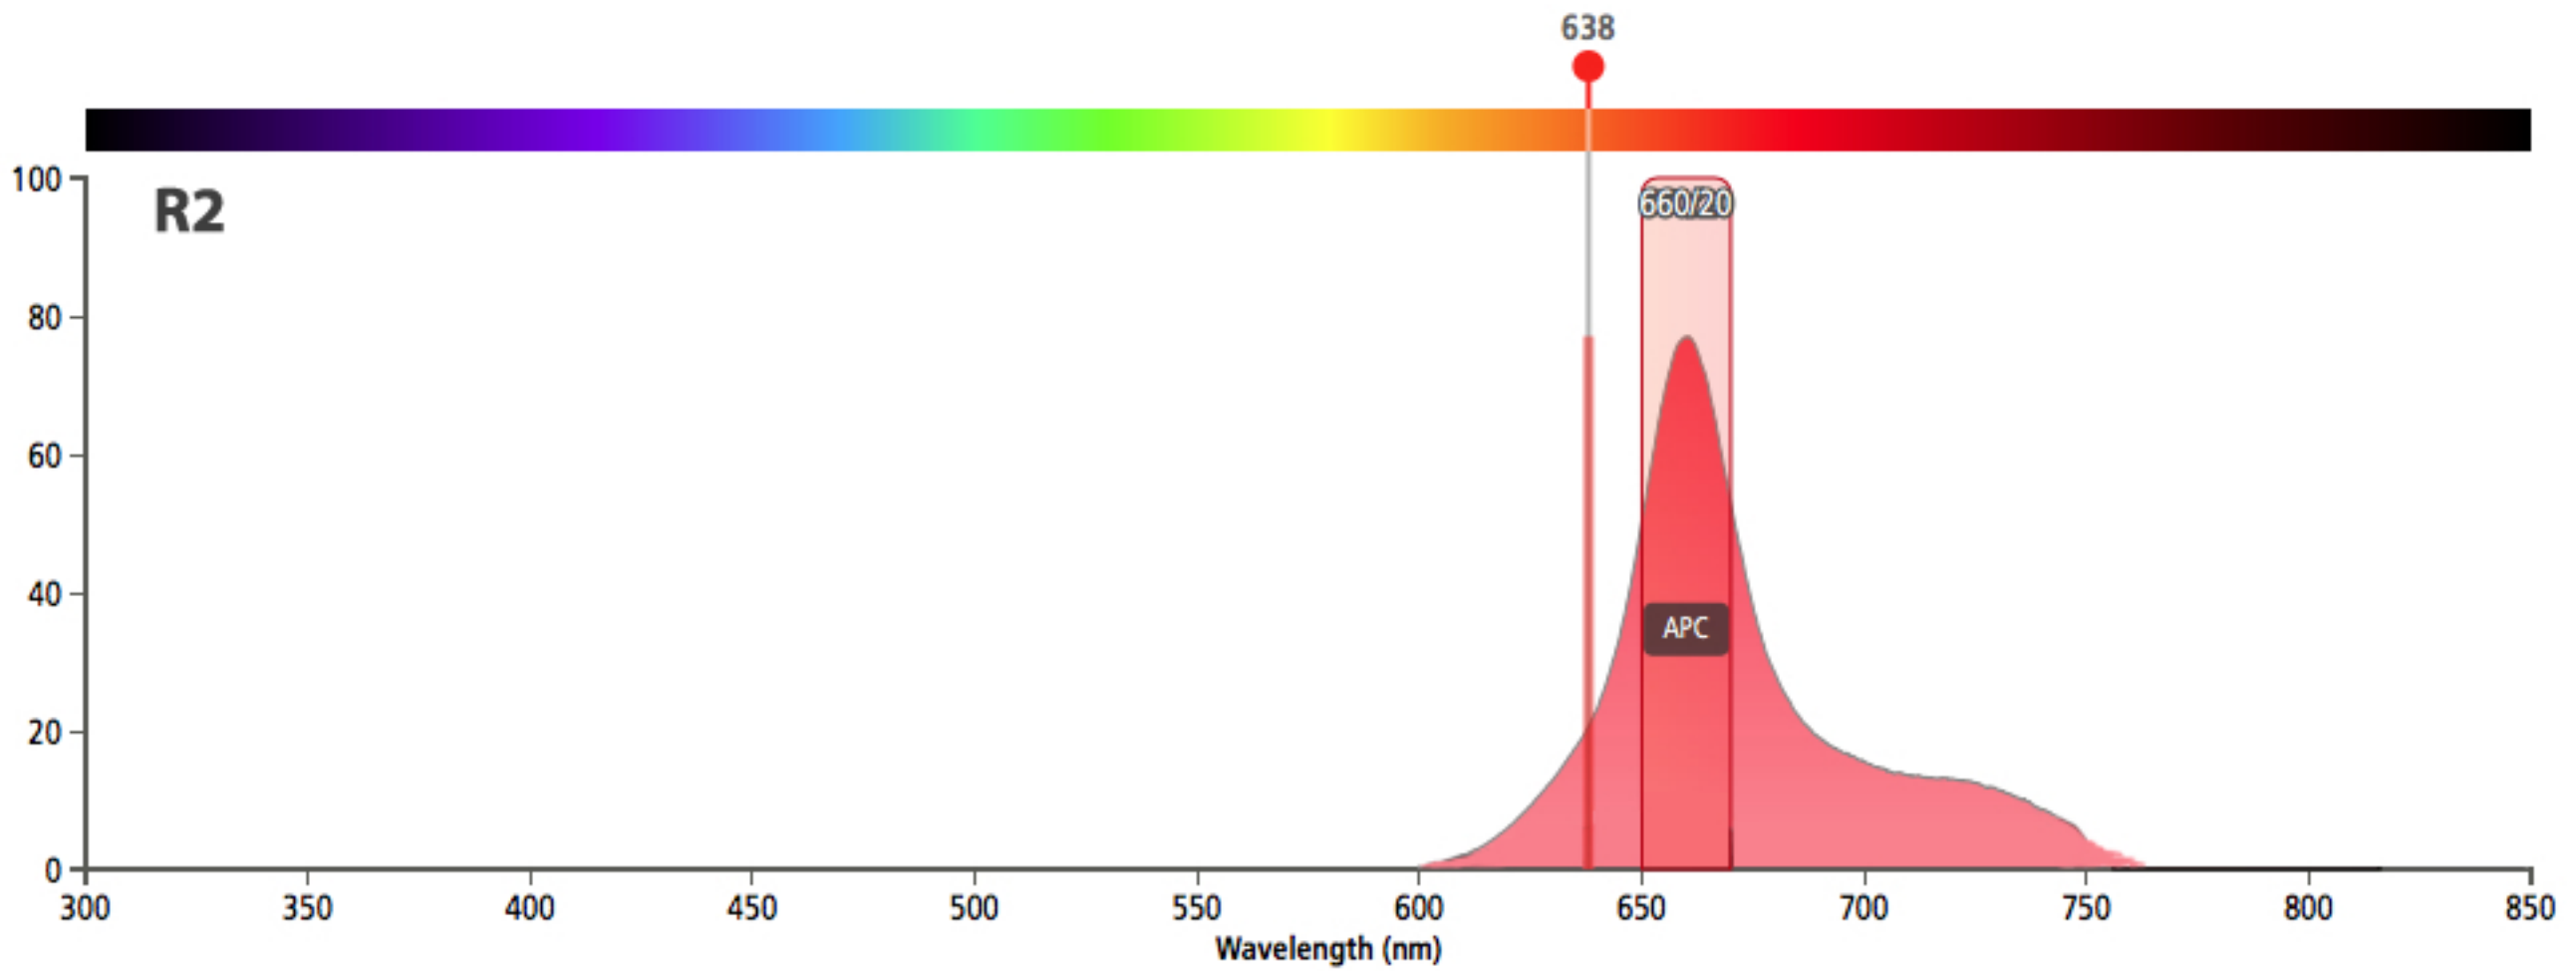

Fluorochrome	%Max	<input type="checkbox"/> Ex	<input checked="" type="checkbox"/> Em	Filters	<input checked="" type="checkbox"/> APC
1 APC	77.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	660/20	40.2%